



PLAN VIEW
NTS

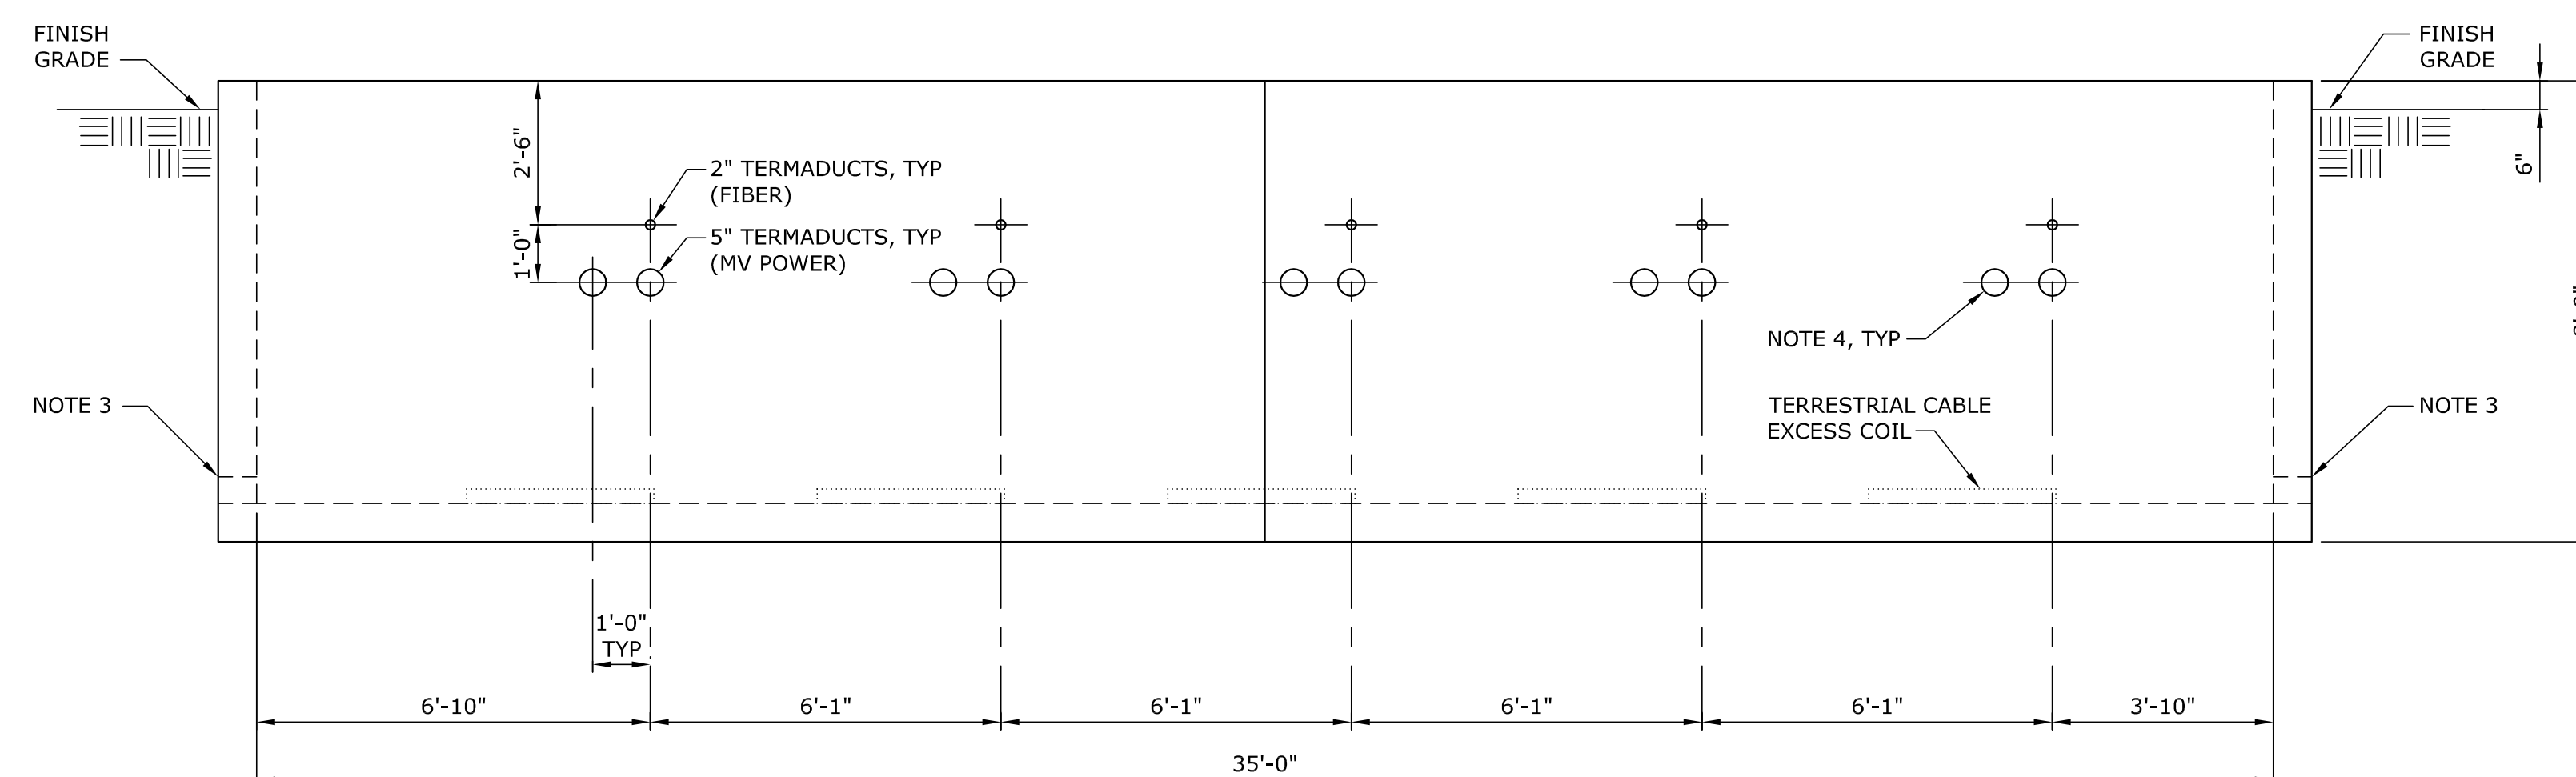

SIDE VIEW

- NOTES:**
1. VAULT FABRICATOR TO INCLUDE PASSIVE DRAINAGE PROVISIONS.
 2. CONDUIT DESIGN TO WEST SIDE OF VAULT BY SUBSEA CABLE DESIGNER AND CONTRACTOR. SUGGESTED CONDUIT LOCATIONS ONLY.
 3. REFER TO CIVIL SITE PLAN FOR PASSIVE DRAINAGE AT NORTH AND SOUTH ENDS OF VAULT. CONTRACTOR OR VAULT MANUFACTURER TO CORE DRILL 3"Ø HOLE IN VAULT WITH BOTTOM OF HOLE AT THE FLOOR ELEVATION OF VAULT. THIS HOLE WILL BE USED FOR SITE PASSIVE DRAINAGE DESIGNED BY HGE.
 4. CONTRACTOR OR VAULT MANUFACTURER TO CORE DRILL HOLES FOR CONDUIT ENTRY.
 5. ALL JUNCTION AND VAULT ENTRY POINTS TO BE WATERTIGHT.

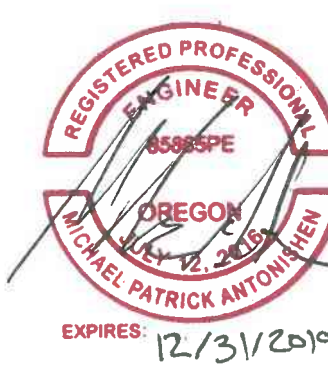

TriAxis

A DIVISION OF
DAVID EVANS AND ASSOCIATES

NO.	DATE	REVISION
B	09/18/19	ISSUED FOR BIDDING
A	08/28/19	PRELIMINARY FOR DOE/OWNER REVIEW



DESIGNED BY:	P OSWALD	DATE:	SEP 2019
DRAFTED BY:	M GUIDOTTI	DRAWING NO.:	ORSU000018100C6-03
CHECKED BY:	M ANTONISHEN	PROJECT NO.:	ORSU000018100
APPROVED BY:	M ANTONISHEN	REVISION NO.:	B

OREGON STATE UNIVERSITY
CORVALLIS, OR

PACWAVE UTILITY CONNECTION AND MONITORING FACILITY
VAULT DETAILS - TERRESTRIAL VAULT

SHEET NO. C6-03

ISSUED FOR BIDDING

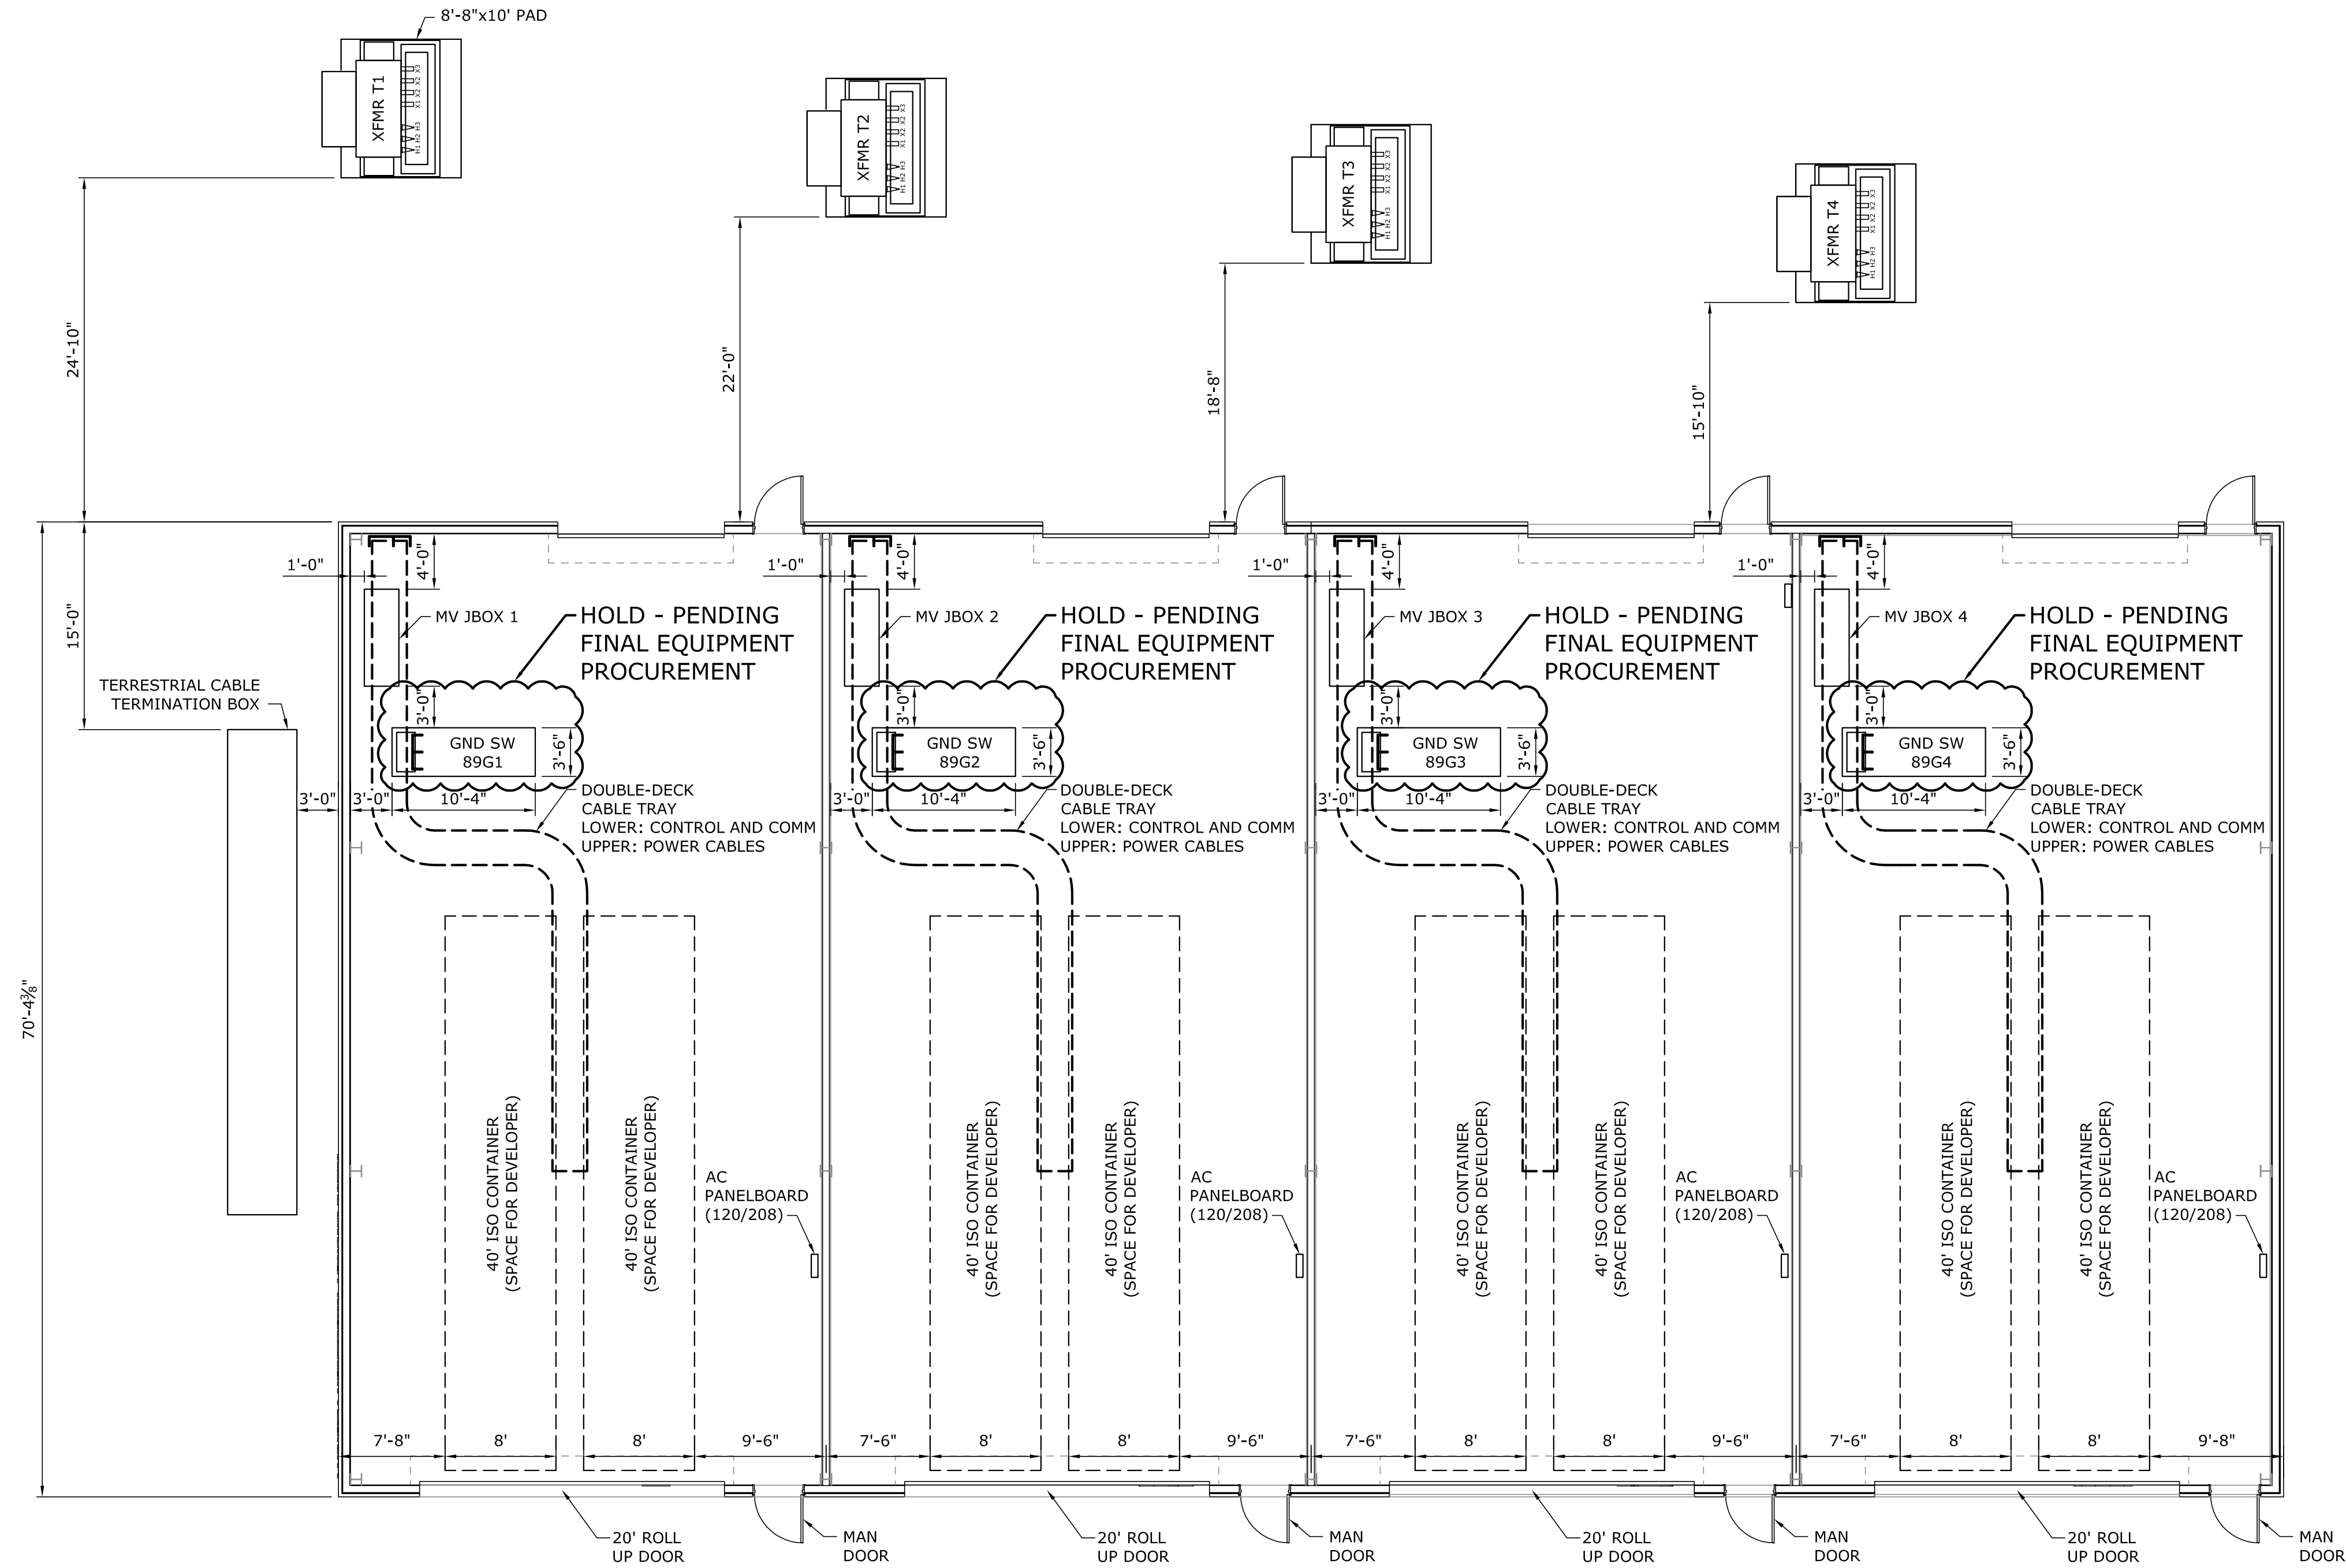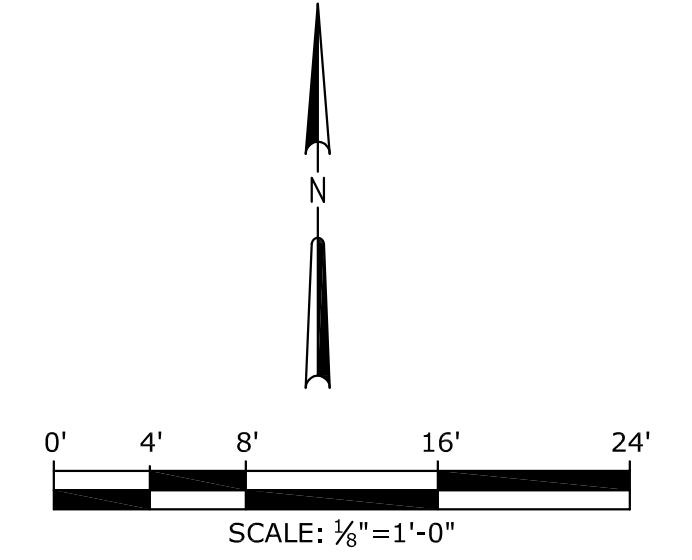

TriAxis
A DIVISION OF
DAVID EVANS AND ASSOCIATES

NO.	DATE	REVISION
F	09/18/19	ISSUED FOR BIDDING
E	08/28/19	PRELIMINARY FOR DOE/OWNER REVIEW
D	6/21/19	UPDATE FOR 30% REVIEW
C	10/09/18	GROUND SWITCH
B	10/09/18	REVISED PER REVIEW COMMENTS

DR	BY	APVD
MDG	PTO	MPA
MDG	PTO	MPA
LB	FBB	MPA
LB	JCS	MPA
TWW	JCS	MPA

DESIGNED BY:	M ANTONISHEN	DATE:	SEP 2019
DRAFTED BY:	M GUIDOTTI	DRAWING NO.:	ORSU000018100E1-01
CHECKED BY:	M ANTONISHEN	PROJECT NO.:	ORSU000018100
APPROVED BY:	M ANTONISHEN	REVISION NO.:	F

OREGON STATE UNIVERSITY
CORVALLIS, OR

PACWAVE UTILITY CONNECTION AND MONITORING FACILITY
PLAN VIEW - DEVELOPER EQUIPMENT BAYS 1-4

SHEET NO.
E1-01

ISSUED FOR BIDDING