SEQ 10
INSTALL 3PH GROUND SLEEVE SECTIONALIZER CONDUITS TO BE CUT AND REROUTED INTO NEW GROUND SLEEVE W/36IN RADIUS BLACK FIBERGLASS RED STRIPE SWEEPS.

SEQ 10-SEQ 20
INSTALL 30FT OF 7.2KV 1-1/0AL UG PRIM CABLE

SEQ 20
INSTALL 1PH 75KVA 120/240V PADMOUNT XFMR
INSTALL 80FT 1-350AL TRIPLEX SERVICE CABLE
INSTALL 1-CLASS 320 1PH 240V DEMAND METER

SEQ 20-SEQ 40
INSTALL 150FT OF 12.5KV 3-1/0AL UG PRIM CABLE

SEQ 30-SEQ 40
REMOVE 450FT OF 12.5KV 3-1/0AL UG PRIM CABLE

SEQ 30-SEQ 10
INSTALL 300FT OF 12.5KV 3-1/0AL UG PRIM CABLE

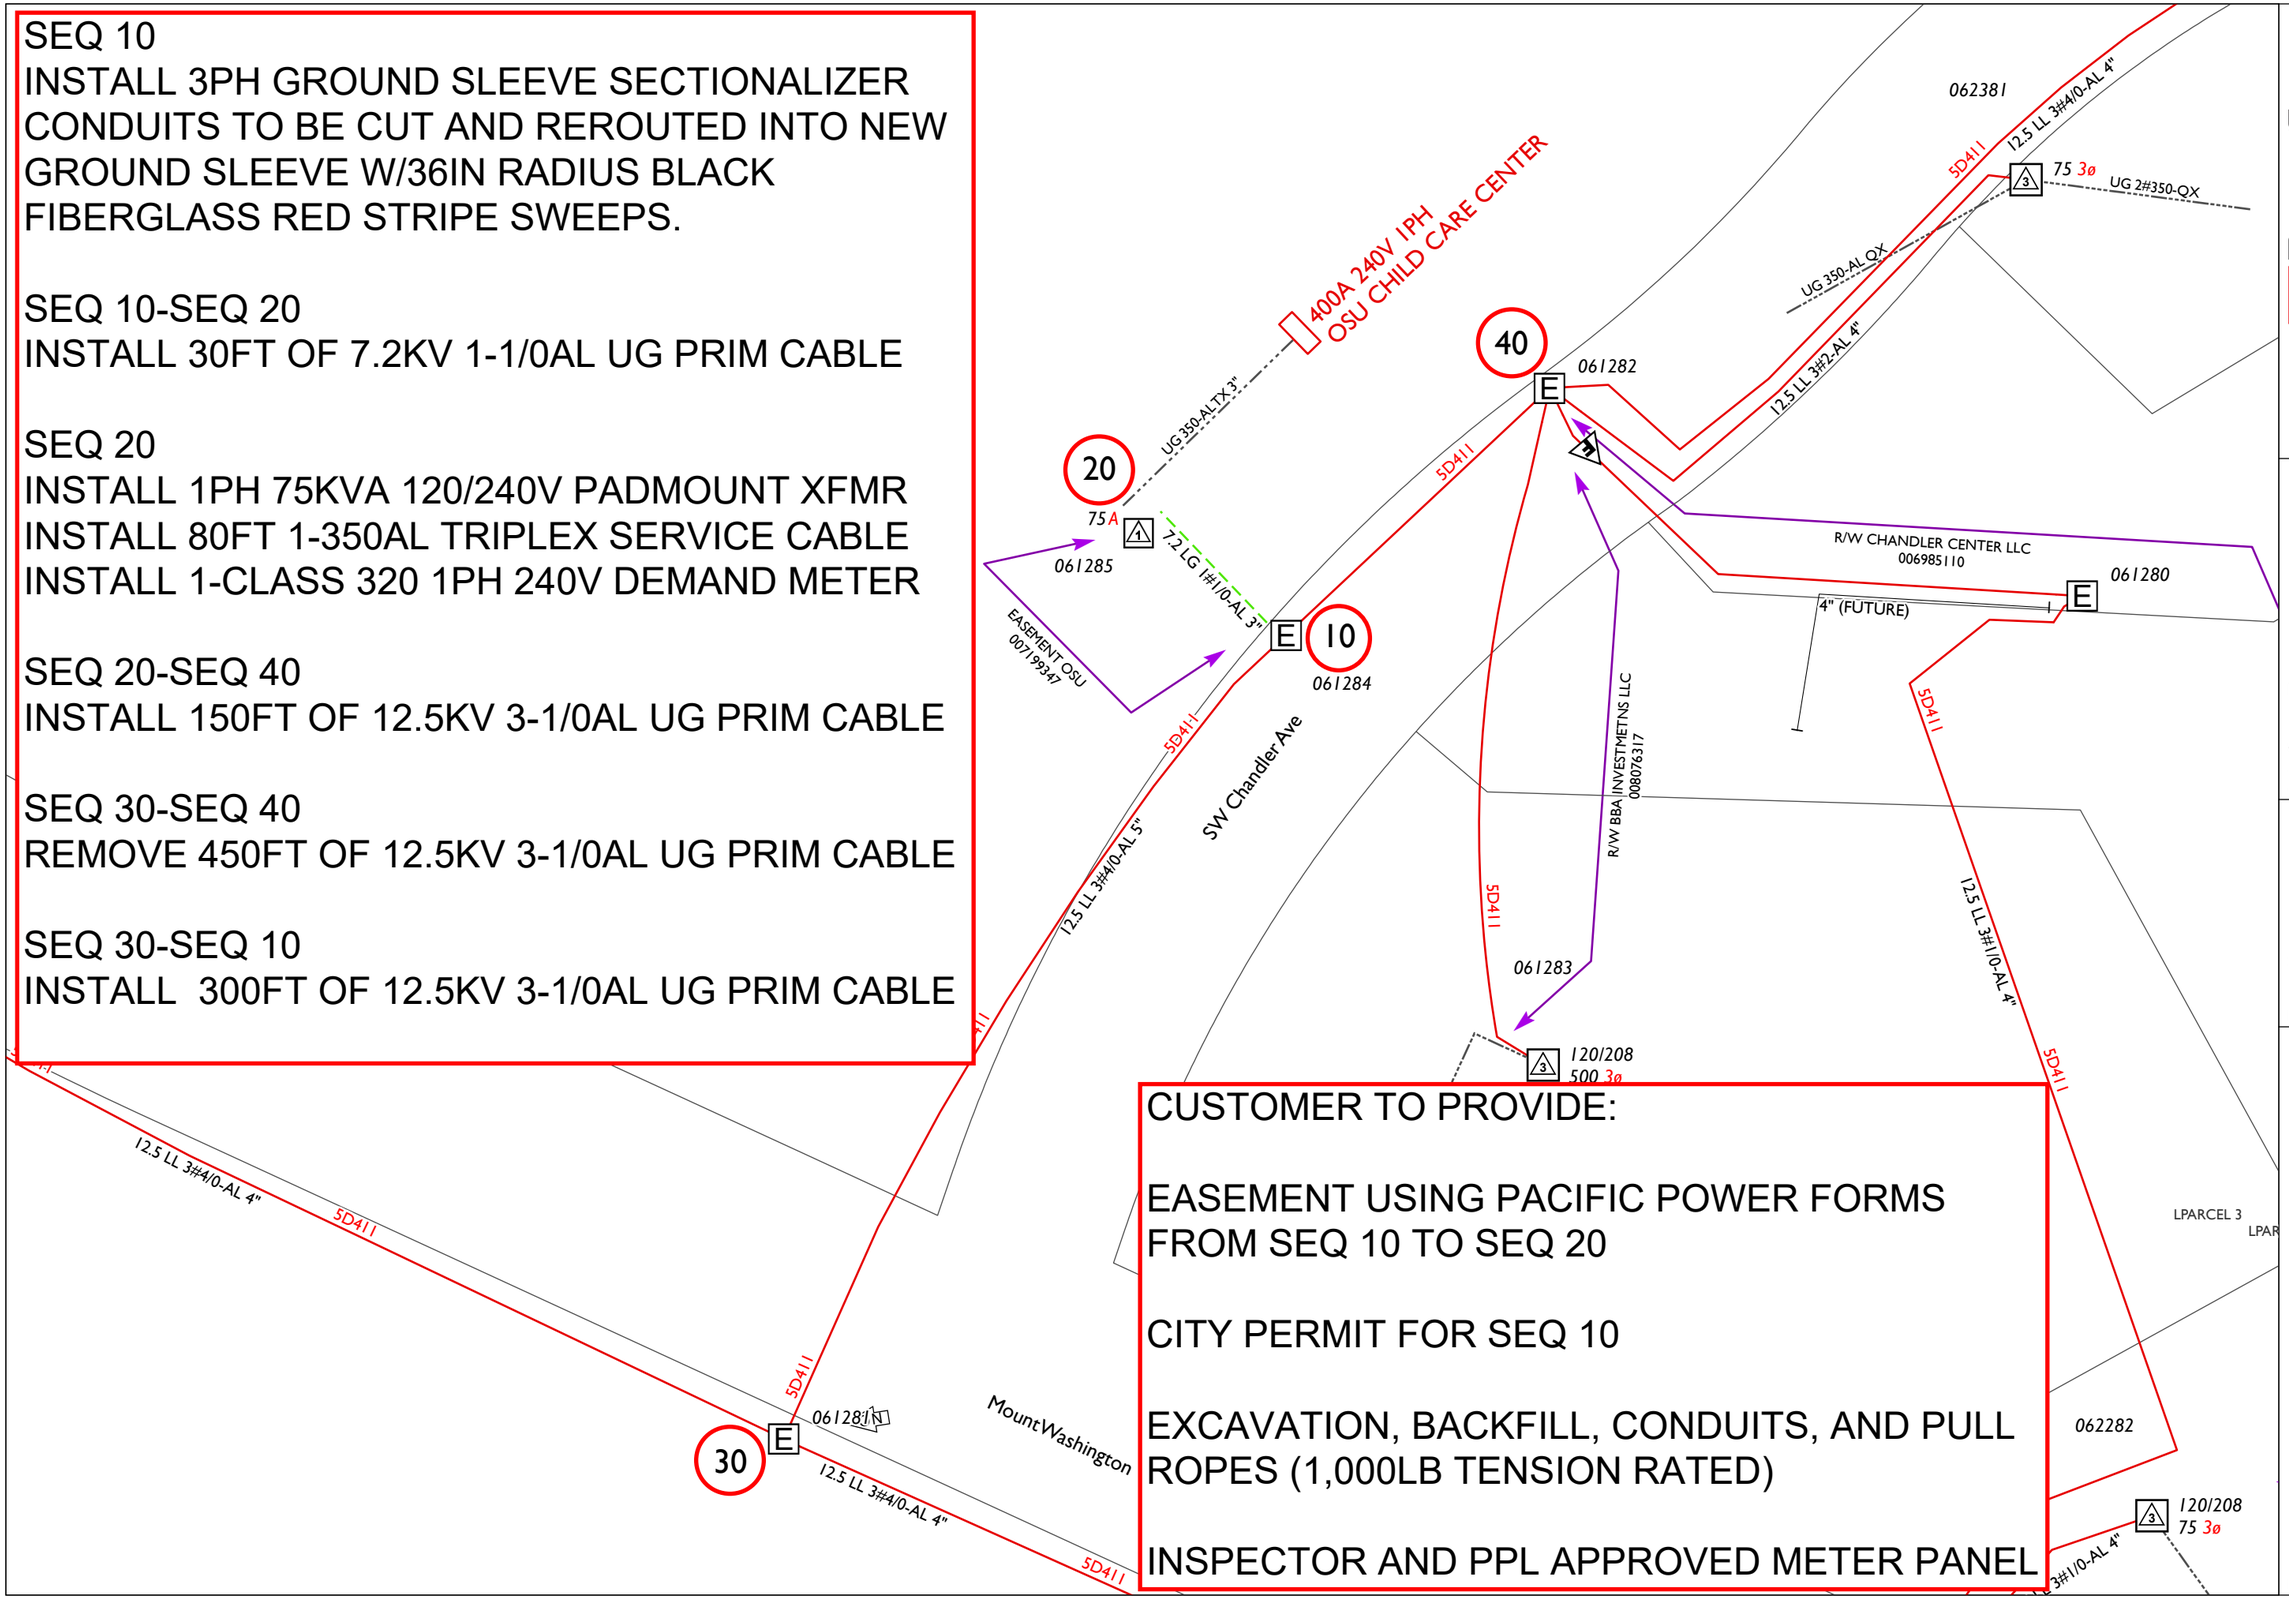

CUSTOMER TO PROVIDE:

EASEMENT USING PACIFIC POWER FORMS FROM SEQ 10 TO SEQ 20

CITY PERMIT FOR SEQ 10

EXCAVATION, BACKFILL, CONDUITS, AND PULL ROPES (1,000LB TENSION RATED)

INSPECTOR AND PPL APPROVED METER PANEL

PACIFICORP
A BERKSHIRE HATHAWAY ENERGY COMPANY

Page 1 of 1

N W E S

Scale	1 in = 50'
Print Date	5/9/2024
EST ID#	P60642
Post Jobs ☐ RQII ☐ Posted ☐	
Job Start Date	
Job Comp Date	
Circuit	5D411
Emp #	
Map String	0141801 2.0
Foreman	
WO# / REQ#	00719934 7
CC#	11216
Customer:	OSU CASCADES
Address:	1757 SW SIMPSON AVE, BEND, OR 97702