


### LAYOUT NOTES

**FIELD & TRACK CONTINUED FROM SHEET F-1.1:**

11. SURFACE PLANARITY AND DENSITY REQUIREMENTS MUST BE VERIFIED AT THE FOLLOWING MILESTONES:
  - FIELD SUBGRADE PRIOR TO FIELD SUBSURFACE DRAINAGE INSTALLATION
  - FIELD BASE COURSE PERMEABLE AGGREGATE PRIOR TO TOP COURSE PLACEMENT
  - FIELD TOP COURSE PERMEABLE AGGREGATE PRIOR TO SYNTHETIC TURF INSTALLATION
  - FIELD EVENT AND TRACK SUBGRADE PRIOR TO BASE AGGREGATE PLACEMENT
  - FIELD EVENT AND TRACK BASE AGGREGATE PRIOR TO PAVEMENTS
  - TRACK AND FIELD EVENT ASPHALT LIFT 1 PRIOR TO 2, AND 2 PRIOR TO RUBBERIZED SURFACING
  - FIELD EVENT CONCRETE PAVEMENT FINISH PRIOR TO RUBBERIZED SURFACING
12. ASPHALT AND CONCRETE PAVING REQUIRE VARYING DEGREES OF CURING TIME BEFORE RUBBERIZED SURFACING CAN BE INSTALLED. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO MAKE ALLOWANCES FOR THIS IN SCHEDULING THE WORK SEQUENCE.
13. UPON APPROVAL OF THE TOP COURSE PERMEABLE AGGREGATE INSTALL SYNTHETIC TURF SURFACING. DO NOT INCORPORATE ADHESIVES INTO THE WORK WHERE ENVIRONMENTAL CONDITIONS ARE NOT AS DIRECTED, I.E. TEMPERATURES BELOW 45 DEGREES FARENHEIT OR ACTIVE RAIN. DO NOT INSTALL INFILL MATERIALS DURING PERIODS OF RAIN.
14. PRIOR TO INSTALLATION OF THE TRACK AND FIELD EVENT RUBBERIZED SURFACING, ALL PAVING SHALL BE CHECKED FOR PLANARITY BY THE ENGINEER, GENERAL CONTRACTOR, PAVING SUBCONTRACTOR, AND RUBBERIZED SURFACING SUBCONTRACTOR. GENERAL CONTRACTOR TO ARRANGE FOR ALL NECESSARY CORRECTIVE WORK IDENTIFIED BY THE PARTIES.
15. FINISH SURFACE PLANARITY OF ASPHALT SHALL NOT DEVIATE MORE THAN 1/8" WHEN MEASURED WITH A 10 FOOT STRAIGHT EDGE IN ANY DIRECTION.
16. THE CONTRACTOR SHALL PROTECT ALL ADJACENT AREAS FROM ANY SPLATTER OR OVERSPRAY FROM THE RUBBERIZED SURFACING INSTALLATION PROCEDURES USING PLASTIC SHEETING AS NEEDED.
17. APPLY SUCH PRIMING MATERIAL AS MAY BE NECESSARY TO ASSURE COMPLETE BOND OF POLYURETHANE TO THE CONCRETE CONTAINMENT/TERMINATION.

**18. RUBBERIZED SURFACING PRODUCT:**

- **BASE BID:** THE SURFACING SHALL BE A 13MM TOTAL DEPTH SEALED BASE MATT AND RED STRUCTURAL SPRAY SYSTEM. IT SHALL INCLUDE A RUBBER BASE MATT BOUND WITH POLYURETHANE PAVED OVER THE APPROVED ASPHALTIC AND CONCRETE BASE. THE RUBBER BASE FOR ALL AREAS OF RUBBERIZED SURFACING SHALL BE SEALED WITH A RED PIGMENTED TWO-COMPONENT POLYURETHANE. ALL AREAS OF RUBBERIZED SURFACING SHALL INCLUDE A TOP COATING OF SINGLE COMPONENT POLYURETHANE RED PIGMENTED COATING WITH RED EPDM RUBBER GRANULES. TOPCOAT OF RUNNING TRACK TO BE OF TWO APPLICATIONS.
  - **ALTERNATE BID ITEM:** PROVIDE A 13MM SANDWICH SYSTEM, COMPRISED OF AN 8-9MM PAVED AND SEALED BASE MATT AS DESCRIBED ABOVE, WITH A 4-6MM FLOOD AND CHIP SURFACE, COLOR RED.
19. TRACK AND FIELD EVENT SURFACING CONTRACTOR WILL PROVIDE THE NECESSARY DEPRESSIONS IN THE CONCRETE SLAB AND AN OVERALL THICKNESS OF 20MM RUBBERIZED SURFACING LOCATED AT THE HIGH JUMP, LONG JUMP/ TRIPLE JUMP, POLE VAULT, AND JAVELIN RUNWAYS, AND 25MM AT THE STEEPLE CHASE WATER JUMP LANDING ZONE.
  20. THE CONTRACTOR WILL BE RESPONSIBLE FOR LOCATING THE RADIUS POINTS REQUIRED FOR INSURING THE PROPER LAYOUT OF THE RUNNING LANES AND EVENTS, AND VERIFYING MEASUREMENT FOR THE PURPOSES OF CERTIFICATION.
  21. FURNISH AND INSTALL COMPLETE TRACK AND FIELD EVENT LINES AND MARKINGS TO NCAA REQUIREMENTS AND AS DESCRIBED ELSEWHERE.
  22. INSTALL TAKE-OFF BOARDS SUPPLIED BY OWNER (F.O.I.C.) INCLUDING RUBBERIZED SURFACING.
  23. PROVIDE NEW VAULT BOXES AND CONCRETE STANCHION PADS.
  24. PROVIDE PIGMENTED, POLYURETHANE "PLUG" FOR TWO VAULT BOXES.
  25. TRACK & FIELD EVENT SURFACING CONTRACTOR TO SUPPLY SURVEY, AND INSTALL REMOVABLE COMPETITION CURB. DEMONSTRATE INSTALLATION AND REMOVAL. REFER TO F-1.1 FOR TERMINATIONS.

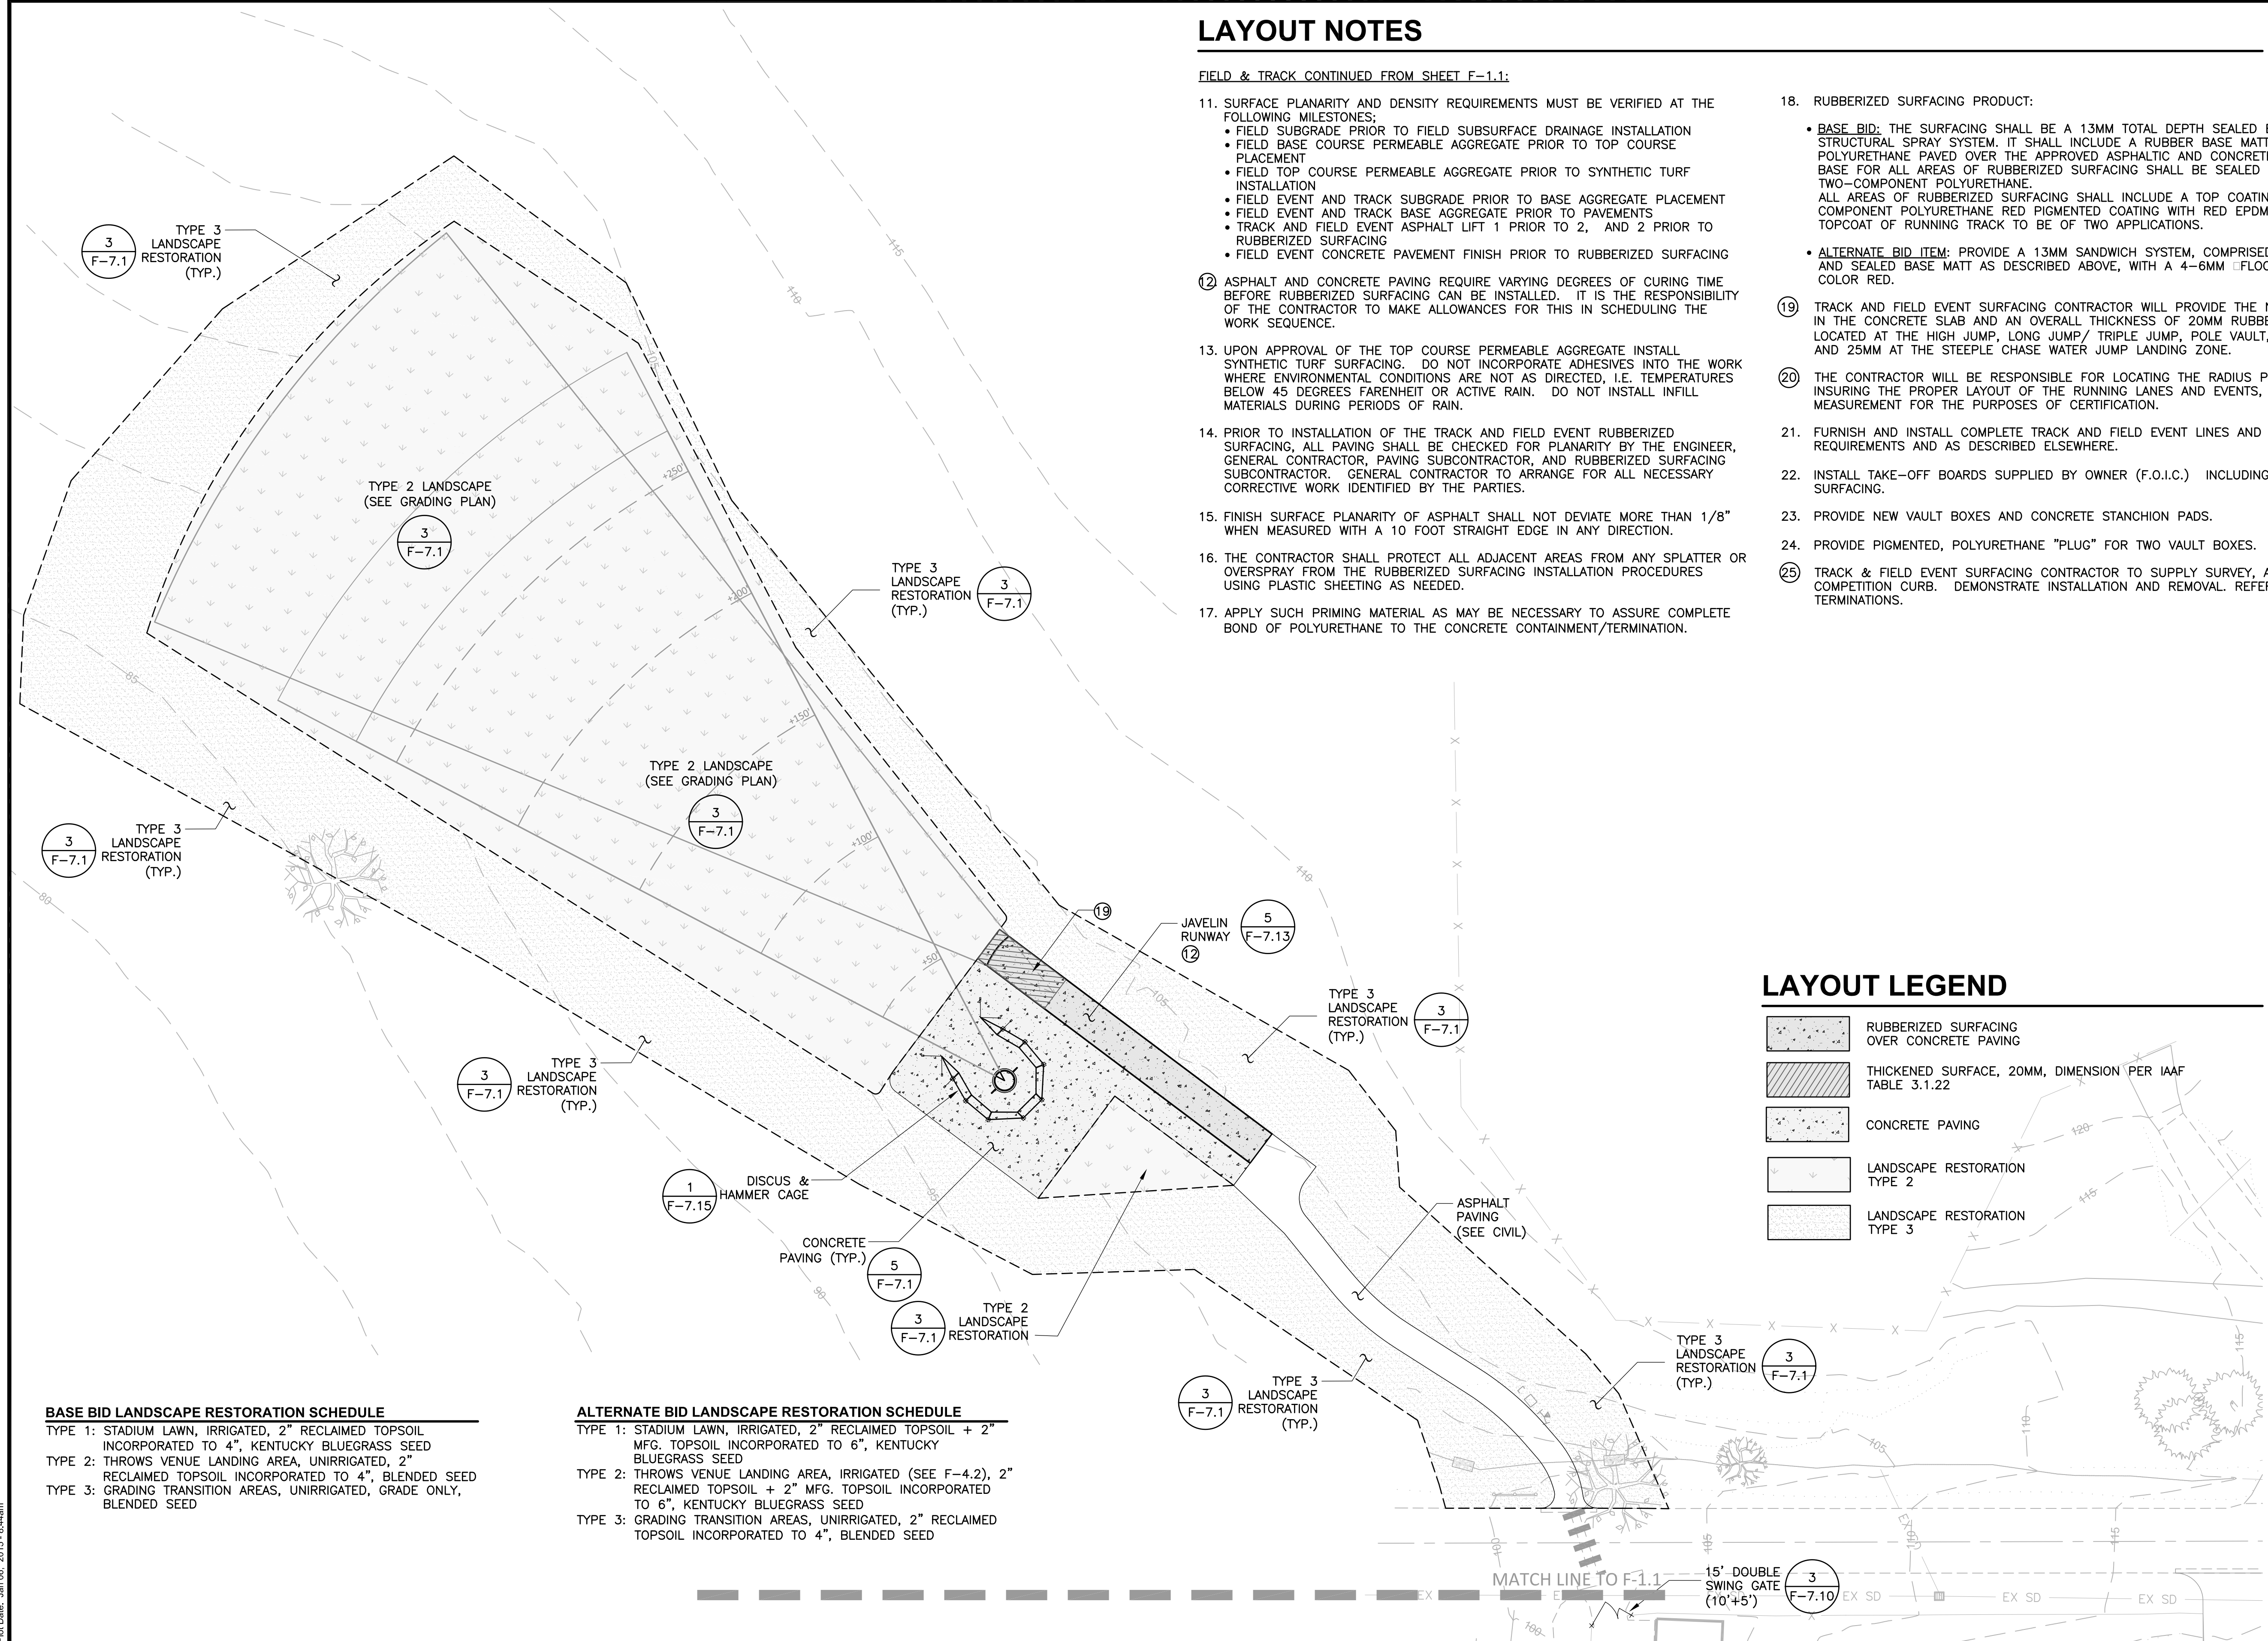

### LAYOUT LEGEND


- RUBBERIZED SURFACING OVER CONCRETE PAVING
- THICKENED SURFACE, 20MM, DIMENSION PER IAAF TABLE 3.1.22
- CONCRETE PAVING
- LANDSCAPE RESTORATION TYPE 2
- LANDSCAPE RESTORATION TYPE 3

**BASE BID LANDSCAPE RESTORATION SCHEDULE**

- TYPE 1: STADIUM LAWN, IRRIGATED, 2" RECLAIMED TOPSOIL INCORPORATED TO 4", KENTUCKY BLUEGRASS SEED
- TYPE 2: THROWS VENUE LANDING AREA, UNIRRIGATED, 2" RECLAIMED TOPSOIL INCORPORATED TO 4", BLENDED SEED
- TYPE 3: GRADING TRANSITION AREAS, UNIRRIGATED, GRADE ONLY, BLENDED SEED

**ALTERNATE BID LANDSCAPE RESTORATION SCHEDULE**

- TYPE 1: STADIUM LAWN, IRRIGATED, 2" RECLAIMED TOPSOIL + 2" MFG. TOPSOIL INCORPORATED TO 6", KENTUCKY BLUEGRASS SEED
- TYPE 2: THROWS VENUE LANDING AREA, IRRIGATED (SEE F-4.2), 2" RECLAIMED TOPSOIL + 2" MFG. TOPSOIL INCORPORATED TO 6", KENTUCKY BLUEGRASS SEED
- TYPE 3: GRADING TRANSITION AREAS, UNIRRIGATED, 2" RECLAIMED TOPSOIL INCORPORATED TO 4", BLENDED SEED

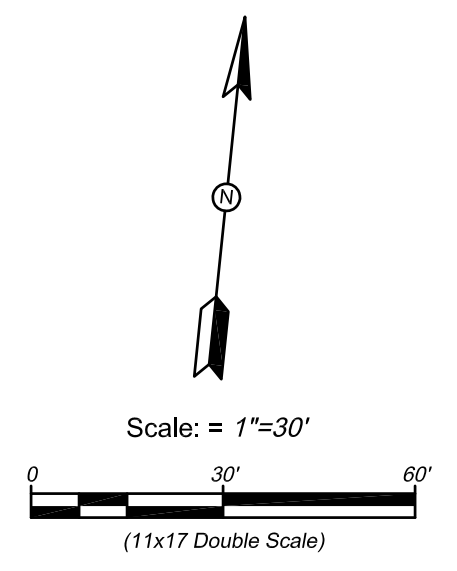


www.AuslandGroup.com  
 Ashland 541.482.0923  
 Eugene 541.345.1094  
 Grants Pass 541.476.3788  
 Medford 541.773.3387



Drawn By:	CPW, JS	Director Decision Date:	N/A
Designed By:	EJG	First Submittal Date:	07/07/2015
Checked By:	EJG, RSH	Second Submittal Date:	
Approved:		City Approval Date:	
Rev 1		By:	
Rev 2		By:	
Rev 3		By:	
As-Built			

**OREGON TECH TRACK AND SOCCER PROJECT**  
 CONSTRUCTION DOCUMENTS  
 MAP NO. 38-09-00, TAX LOT 4900  
 3201 CAMPUS DRIVE, KLAMATH FALLS, OREGON  
 CITY PROJECT NO. OIT-2704-P-13-17

VERIFY SCALES  
 ORIGINAL DRAWING: 1"=10' ON  
 IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY

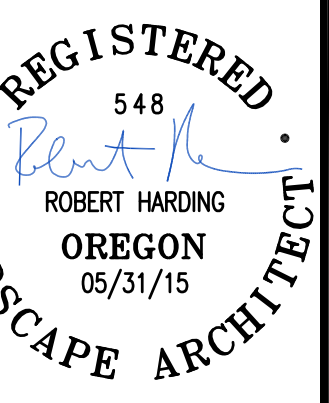

SHEET  
**F-1.2**  
 FIELD EVENTS LAYOUT PLAN